

**DAILY SUMMARY REPORT**

Report Date: 8/15/01

Time	Gas Burner	Sludge Feed	O2W %		THC 402 PPM		Stack Temp		Sludge Feed		Moist Fract		O2D %		THC Corr PPM	
0:00	ON	ON	14.08	0	14.52	0	96.40	0	4.87	0	0.06	0	14.91	0	33.09	0
1:00	ON	ON	13.50	0	15.03	0	97.78	0	5.56	0	0.06	0	14.34	0	31.01	0
2:00	ON	ON	13.68	0	22.95	0	98.09	0	5.11	0	0.06	0	14.54	0	49.71	0
3:00	ON	ON	14.52	0	16.10	0	96.38	0	5.31	0	0.06	0	15.39	0	40.34	0
4:00	ON	ON	13.94	0	14.84	0	97.01	0	5.25	0	0.06	0	14.78	0	33.06	0
5:00	ON	ON	14.47	0	14.91	0	95.53	0	5.06	0	0.06	0	15.30	0	36.86	0
6:00	ON	ON	13.94	0	12.77	0	96.73	0	5.66	0	0.06	0	14.78	0	28.53	0
7:00	ON	ON	14.46	0	13.52	0	94.90	0	4.84	0	0.06	0	15.29	0	32.81	0
8:00	ON	ON	14.37	0	23.09	0	95.80	0	5.18	0	0.06	0	15.21	0	52.96	0
9:00	ON	ON	14.20	0	18.74	0	95.61	0	3.41	0	0.06	0	15.03	0	47.31	0
10:00	ON	ON	16.83	0	62.37	0	85.14	0	2.52	0	0.04	0	17.51	0	253.02	0
11:00	ON	ON	17.24	0	73.98	0	83.53	0	1.26	0	0.04	0	17.91	0	333.03	0
12:00	ON	ON	16.15	0	46.51	0	88.82	0	2.71	0	0.05	0	16.90	0	195.89	0
13:00	ON	ON	14.61	0	13.54	0	94.27	0	4.71	0	0.05	0	15.43	0	33.99	0
14:00	ON	ON	13.05	0	17.92	0	99.51	0	5.27	0	0.06	0	13.91	0	35.04	0
15:00	ON	ON	14.28	0	19.50	0	98.01	0	4.81	0	0.06	0	15.18	0	48.32	0
16:00	ON	ON	13.55	0	20.86	0	99.58	0	5.45	0	0.06	0	14.44	0	43.62	0
17:00	ON	ON	15.09	0	34.15	0	97.81	0	4.73	0	0.06	0	16.03	0	98.99	0
18:00	ON	ON	14.40	0	24.85	0	98.25	0	5.29	0	0.06	0	15.30	0	61.49	0
19:00	ON	ON	13.75	0	17.09	0	97.36	0	5.43	0	0.06	0	14.59	0	36.92	0
20:00	ON	ON	13.99	0	17.67	0	97.50	0	5.41	0	0.06	0	14.85	0	39.96	0
21:00	ON	ON	13.95	0	16.63	0	97.00	0	4.65	0	0.06	0	14.79	0	37.18	0
22:00	ON	ON	14.75	0	14.62	0	94.86	0	4.77	0	0.06	0	15.59	0	37.73	0
23:00	ON	ON	13.18	0	18.60	0	98.98	0	5.72	0	0.06	0	14.03	0	36.82	0
<b>Averages</b>			<b>14.42</b>		<b>23.53</b>		<b>95.62</b>		<b>4.71</b>		<b>0.06</b>		<b>15.25</b>		<b>69.90</b>	

**MONTHLY SUMMARY REPORT**


Report Date: **8/15/01**

Date	Gas Burner	Sludge Feed	O2W %	THC 402 PPM	Stack Temp	Sludge Feed	Moist Fract	O2D %	THC Corr PPM
1	ON	ON	13.80	14.05	96.27	5.66	0.06	14.62	31.91
2	ON	ON	15.72	15.45	91.13	2.65	0.05	16.50	58.71
3	ON	OFF	17.98	70.46	87.15	1.28	0.04	18.08	194.60
4	ON	OFF	24.85	1.38	103.30	0.01	0.07	20.40	0.00
5	ON	OFF	24.85	0.07	110.25	0.01	0.08	20.40	0.00
6	ON	ON	16.04	22.89	89.31	2.96	0.05	16.80	148.36
7	ON	ON	13.43	14.50	98.42	5.54	0.06	14.30	32.54
8	ON	ON	16.98	19.08	90.95	3.02	0.05	17.84	107.74
9	ON	ON	15.54	21.01	93.66	4.01	0.05	16.42	91.08
10	ON	OFF	2.36	62.39	87.41	1.43	0.04	2.47	48.07
11	ON	OFF	3.43	0.00	95.41	0.01	0.06	3.63	0.00
12	ON	OFF	6.57	2.29	94.65	0.01	0.06	6.55	3.12
13	ON	ON	15.82	33.37	89.07	2.30	0.05	16.55	114.94
14	ON	ON	14.50	15.05	94.74	4.54	0.06	15.33	38.02
15	ON	ON	14.08	21.46	97.48	5.24	0.06	14.95	52.50
16	ON	ON	14.32	17.06	96.55	4.96	0.06	15.19	42.24
17	ON	OFF	16.12	40.43	89.84	2.60	0.05	16.91	277.95
18	ON	OFF	20.82	1.17	98.70	0.01	0.06	20.40	0.00
19	ON	OFF	20.80	1.30	91.12	0.01	0.05	20.40	0.00
20	ON	ON	16.13	33.95	86.87	1.04	0.04	16.81	136.57
21	ON	ON	15.78	40.54	87.67	1.68	0.04	16.47	162.12
22	ON	ON	14.16	23.91	94.42	4.73	0.05	14.95	57.42
23	ON	ON	14.10	18.53	96.46	5.64	0.06	14.94	42.21
24	ON	ON	10.82	26.78	101.73	4.24	0.07	11.58	40.81
25	ON	ON	11.86	21.40	99.49	3.90	0.06	12.63	34.13
26	ON	ON	14.98	47.53	93.59	2.56	0.05	15.66	153.84
27	ON	OFF	15.82	40.41	90.66	1.79	0.05	16.01	124.53
28	ON	OFF	24.85	0.00	99.88	0.01	0.06	20.40	0.00
29	ON	OFF	24.85	0.14	98.01	0.01	0.06	20.40	0.00
30	ON	ON	13.79	16.26	92.48	3.26	0.05	14.51	37.57
31	ON	ON	13.57	10.99	95.01	5.11	0.06	14.35	24.18
<b>Averages</b>			<b>15.44</b>	<b>21.09</b>	<b>94.57</b>	<b>2.59</b>	<b>0.06</b>	<b>15.37</b>	<b>66.30</b>

**Hometown  
Liftstation Data  
April 1, 2008**

<u>STATION NUMBER</u>	<u>PUMP1 HRS TODAY</u>	<u>PUMP1 HRS TOTAL</u>	<u>PUMP2 HRS TODAY</u>	<u>PUMP2 HRS TOTAL</u>	<u>FLOW GALX X 1000 TOTAL</u>
1	0.5	1857	0.4	1821	
2	1.2	2789	1.3	2843	
3	1.7	3298	1.7	3200	
4	0.9	2289	0.8	2212	
5	1.2	2367	1.1	2176	
6	3.4	3598	3.7	3612	
7	2.2	2987	2.0	2876	
8	1.9	2876	2.1	2910	
9	4.2	3890	0.0	1654	
10	0.9	2198	0.8	2015	
11	0.0	1265	3.2	3417	
12	2.5	3196	2.3	3005	
13	2.8	3264	2.9	3398	
14	1.7	2621	1.8	2699	
15	3.1	3143	3.2	3300	
16	5.1	4021	0.0	2980	
17	2.0	2187	2.2	2278	
18	2.6	2543	2.8	2693	
Influent					193057
Effluent					227810

# WATER TOWER

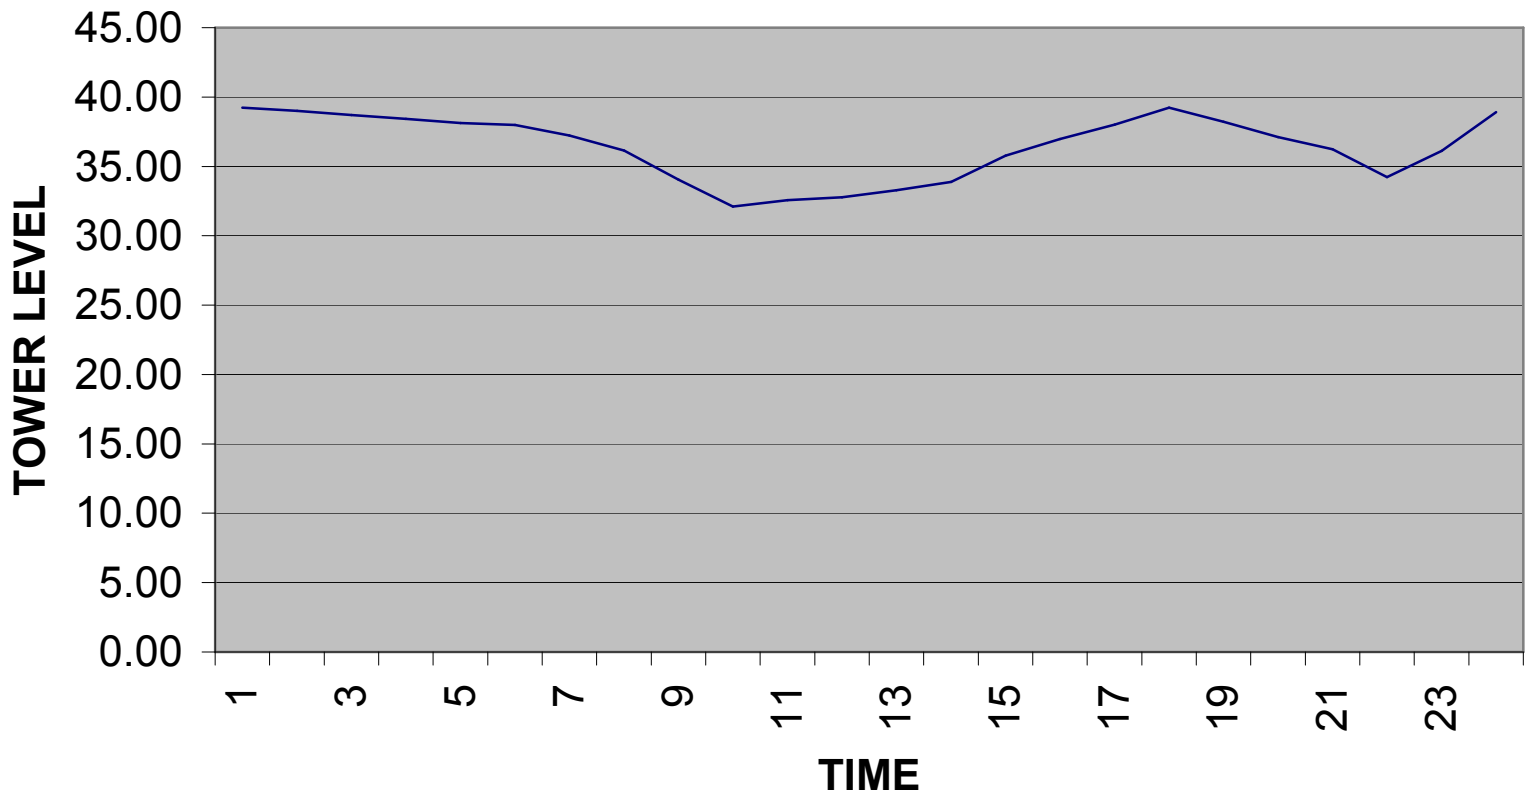

# BEAVER DAM ON 01-01-08

